


RIVIERA UTILITIES
SPECIFICATIONS FOR SINGLE PHASE OVERHEAD SERVICE ENTRANCE
 400 Amps or Less


NOTE: These specs are Riviera's minimum requirements
CONTACT LOCAL CITY INSPECTION DEPTS. FOR ADDITIONAL REQUIREMENTS.
Before Wiring Contact Riviera Utilities For Location of Service Entrance

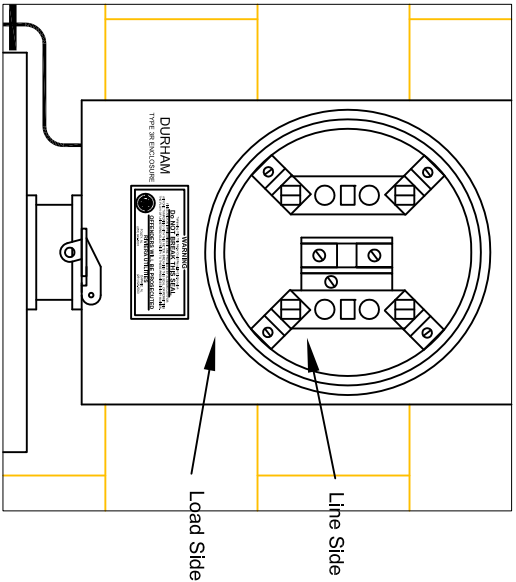

Meter base shall be
 raintight and rated for 100
 amps or greater. Riviera
 will furnish meter base.
**NOTE: HOUSE POWER
 PANELS WILL NOT BE
 ACCEPTED.**

NOTES:

1. Location of service entrance shall be determined by Riviera Utilities.
2. Ground clamp may be below finished grade if an approved underground clamp is used, but must be left visible for inspection.
3. If S.E. Cable is used instead of mast customer must get prior approval and specifications from Riviera Utilities.
4. Ground wire must be secured in a minimum of 2 locations

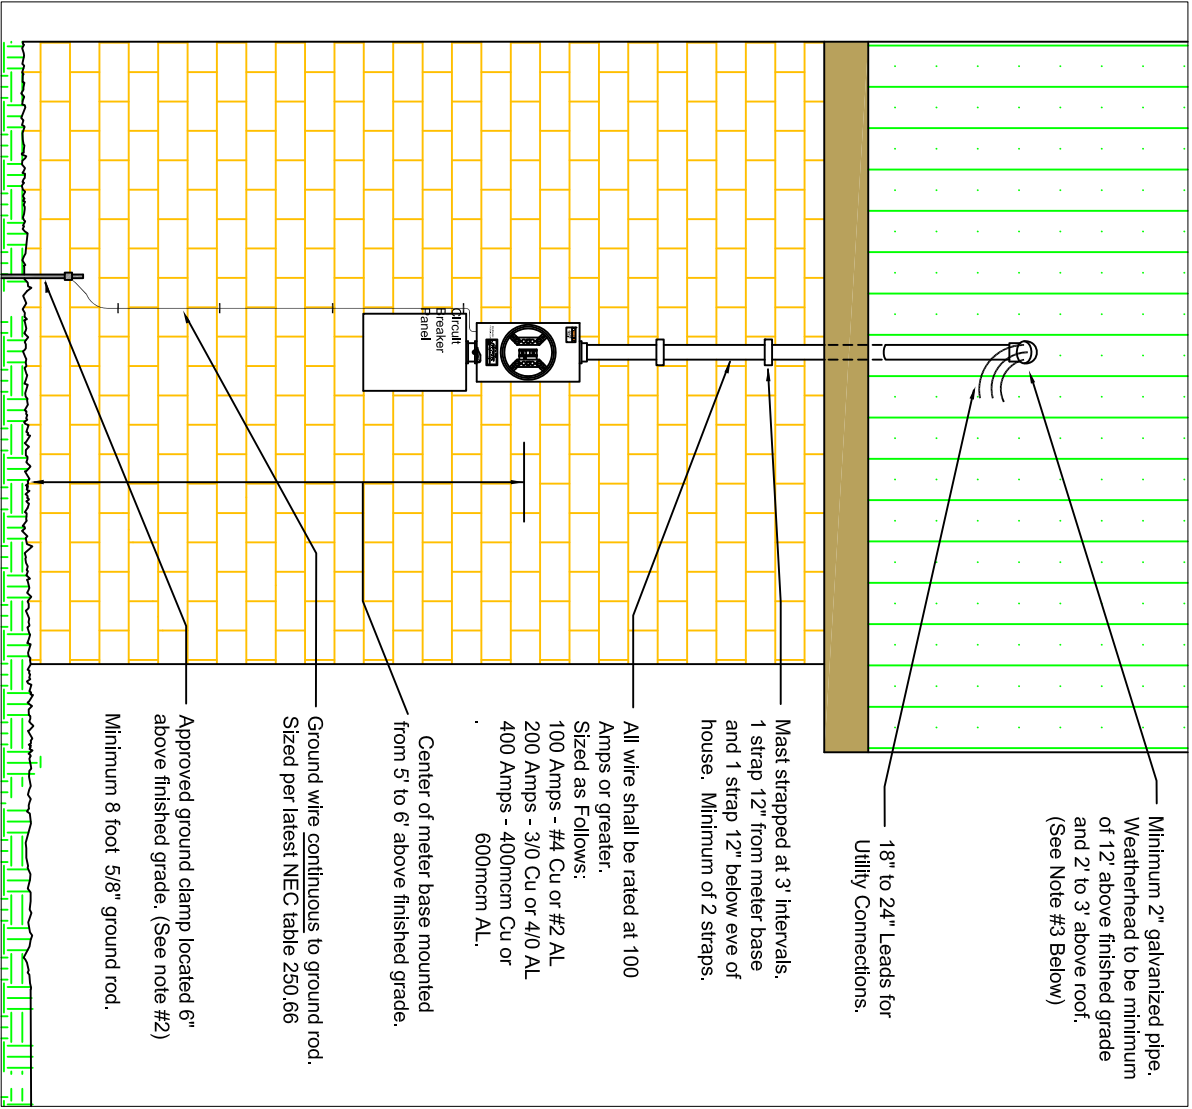

Design Parameters:

REV.	DESC.	DATE

RIVIERA UTILITIES

**120/240V SECONDARY, 1 PHASE,
 OVERHEAD PERMANENT SERVICE**

DRAWN BY: S. TIRADOR	CHKD BY:	Q2.2G
APP'D BY:	DATE: 2/12/14	

4/13