



① PIPE SUPPORT DETAIL  
N.T.S.

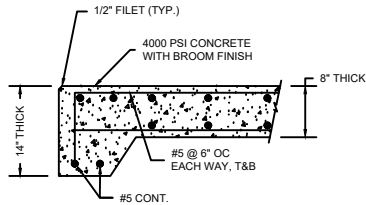


- OTHER DIMENSIONS TO BE DETERMINED BY GENERATOR SIZE  
- MINIMUM OF 1" CLEARANCE AROUND ALL SIDES OF GENERATOR AND/OR TRAILER.

② GENERATOR SLAB DETAIL  
N.T.S.

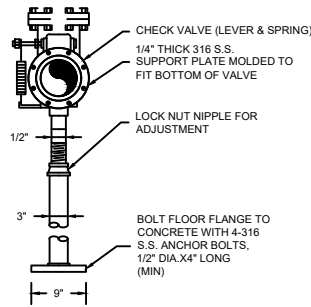


NOTES:  
ADJUSTABLE PIPE SUPPORT "ANVIL FIGURE 265" OR EQUAL  
ALL SUPPORT MATERIALS SHALL BE 316SS  
THE COMPONENTS OF THE VALVE SUPPORT SHALL BE ENLARGED AS APPROVED BY RIVIERA UTILITIES  
QTY: FOUR (4) REQUIRED

④ ADJUSTABLE PIPE STAND DETAIL  
N.T.S.

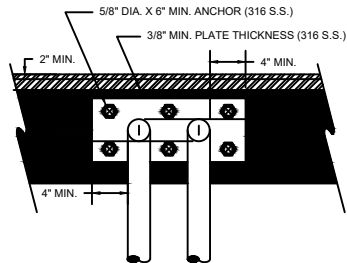


- PUMP RAILS TO BE 2" MIN. 316 S.S. WELDED TO PLATE IN A MANNER ACCEPTABLE TO RIVIERA UTILITIES.

⑤ GUIDE RAIL  
N.T.S.

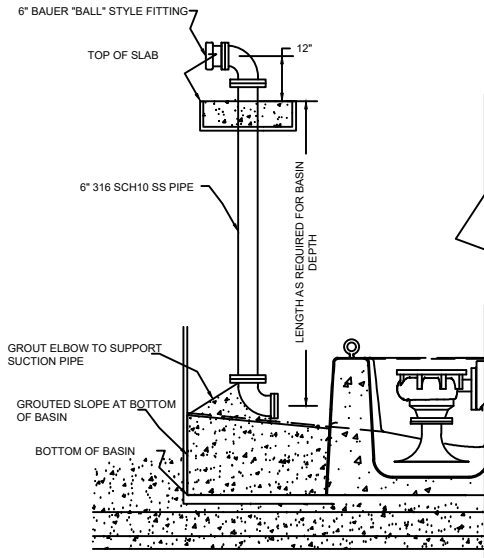


⑥ VERTICAL SUCTION PIPE  
N.T.S.

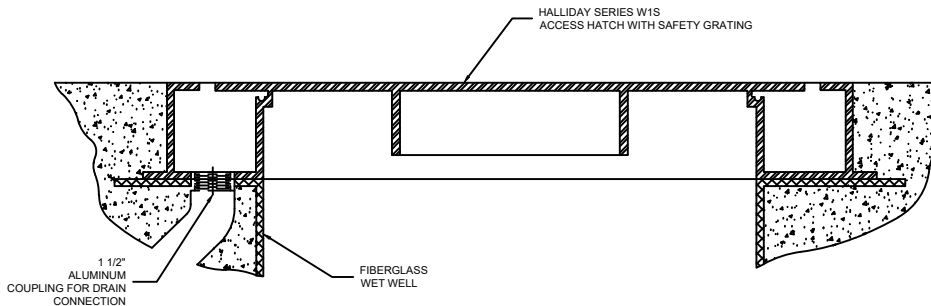


NOTES:  
- ALL ALUMINUM SURFACES IN CONTACT WITH CONCRETE SHALL BE COATED WITH A BITUMASTIC PAINT.  
- HATCH DRAINS TO BE ROUTED TO OUTER EDGE OF TOP SLAB.

⑧ HATCH DETAIL  
N.T.S.

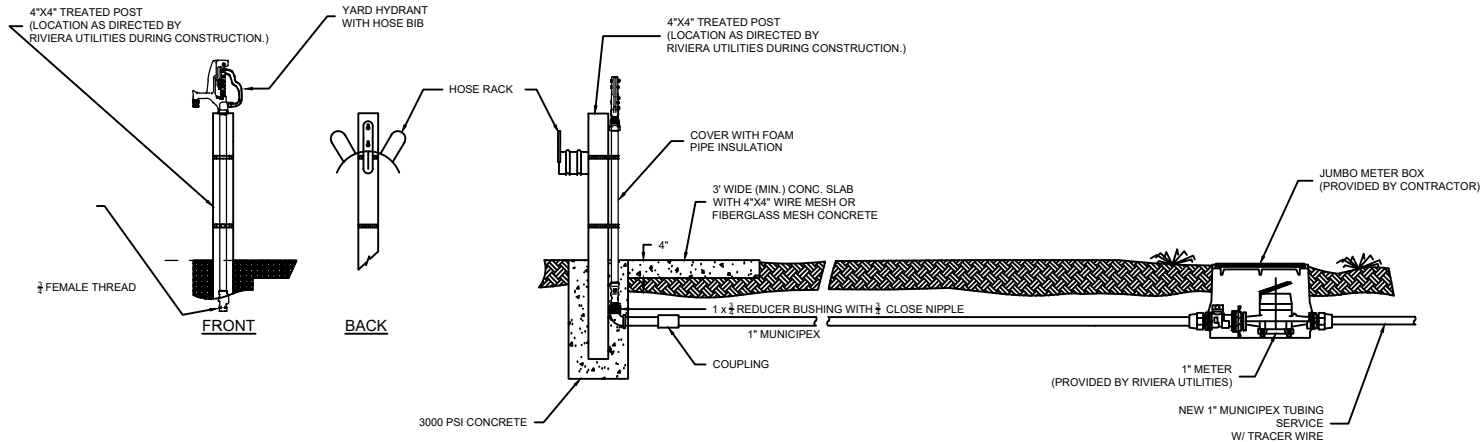

③ LIFT STATION METER DETAIL - 1" SVC  
N.T.S.



NOTES:  
1. ALL DEPTHS ARE COMPACTED DEPTHS.  
2. PREPARE SUBGRADE BY CLEANING AND GRUBBING, STRIPPING TOPSOIL AND PLACING GEOTEXTILE FABRIC.  
3. FILL FOR LIFT STATION SITE SHALL BE SAND MECHANICALLY COMPACTED TO 95% MODIFIED PROCTOR DENSITY IN MAXIMUM 12-INCH LIFTS LOOSE MEASUREMENT TO ACHIEVE CORRECT GRADE.

⑦ LIFT STATION SITE DETAIL  
N.T.S.

GENERAL LIFT STATION NOTES:

1. THE LOCATION OF INFLUENT LINES, WATER SUPPLY, ETC. ARE DRAWN OUT OF ORIENTATION ON SECTIONAL VIEW. SEE PLAN VIEW FOR ORIENTATION. COORDINATE WITH RIVIERA UTILITIES' PERSONNEL FOR EXACT LOCATIONS, AS IT WILL BE SITE SPECIFIC.
2. ALL PENETRATIONS IN WET WELL WALL FOR PIPING, ELECTRICAL, ETC. SHALL BE SEALED & SLEEVED.
3. TO PROTECT STANDPIPE FROM SWAY BRACE, EITHER WRAP PIPE WITH RUBBER SHEETING OR INSERT ALL U-BOLTS THROUGH RUBBER HOSE.
4. PIPING WITHIN THE WET WELL WALL SHALL BE FLANGED SCHEDULE 10 316 STAINLESS STEEL. INTERMEDIATE JOINTS SHALL BE WELDED. FITTINGS WITHIN THE WET WELL SHALL BE FLANGED 316 STAINLESS STEEL. ALL NUTS, BOLTS & ACCESSORIES WITH THE WET WELL SHALL BE 316 STAINLESS STEEL.
5. PIPE AND FITTINGS OUTSIDE OF WET WELL AND ABOVE GROUND SHALL BE 316 STAINLESS STEEL (FLANGED, SCHEDULE 10). ALL WELD-ON FLANGES SHALL BE 125# RFD SOCKET- WELD FLANGE OR RF WELD NECK FLANGE (TYPE). ALL BOLTS, WASHERS AND NUTS SHALL BE 316 STAINLESS STEEL AND SHALL BE COATED WITH "NEVER SEIZE" TYPE COATING.
6. THE ANNULAR SPACE BETWEEN TOP SLAB AND FORCE MAIN PIPE SHALL BE SEALED USING LINK SEALS.
7. PROVIDE PASS THROUGH CONCRETE TOP WITH CAPPED TOP AND OPEN END BOTTOM. SEAL AROUND CONCRETE TOP WITH NON-SHRINK GROUT.
8. INTERIOR SURFACES OF FITTINGS INDICATED, INCLUDING THE FLANGE MATING SURFACES, AS WELL AS THE PUMP IMPELLER, VOLUTE, AND BACKPLATE SHALL BE COATED WITH BELZONA 1321 CERAMIC S-METAL. (UNLESS OTHERWISE SPECIFIED BY OWNER)
9. PLUG VALVES SHALL HAVE AN ALLOWABLE FLOW CAPACITY EQUAL TO 100% OF THE ADJACENT PIPE ARE, AND SHALL ALLOW "PIGGING".
10. THE INTERIOR OF ALL VALVES SHALL BE COATED.
11. CONTRACTOR SHALL PROVIDE ONE 1" CONDUIT FOR PRESSURE TRANSMITTER. CONTRACTOR SHALL TERMINATE WIRES IN OWNER PROVIDED ELECTRICAL CONTROL CABINET.
12. EXHAUST OF ARV'S TO BE FIELD LOCATED AND CONNECTED TO STATION VENT, PROVIDE FITTINGS AS NECESSARY, AND PIPED USING 1.5" 316 S.S. PIPE.
13. LOW LEVEL ALARM ELEV. TO BE SET IN COORDINATION WITH RIVIERA UTILITIES AND PUMP MANUFACTURER..
14. CONNECTION OF SWAY BRACE MOUNTING PLATE SHALL BE COORDINATED WITH PUMP MANUFACTURER.
15. A SECOND BRACE IS TO BE INSTALLED WHEN THE DEPTH OF WET WELL IS GREATER THAN 15' DEEP OR WHEN THE PUMPS ARE GREATER THAN 10HP.
16. FENCE SHALL INCLUDE 14' WIDE MINIMUM GATE OPENING.
17. POUR CONCRETE APRON DESIGNED TO SUPPORT 75,000-LB DUAL AXLE TRUCK, AT LEAST 15' PAST THE RIGHT OF WAY LINE.
18. AS PER SPECIFICATION SECTION 401, THE ELECTRICAL DISCONNECT SHALL BE STAINLESS STEEL AND MOUNTED TO STAINLESS STEEL STRUCTURE.
19. PENETRATIONS FOR ELECTRICAL CONDUITS SHALL BE MADE IN THE RECTANGULAR RISER PORTIONS OF THE WET WELL.
20. LOCATION AND ORIENTATION OF ALL APPURTENANCES SHALL BE COORDINATED WITH RIVIERA UTILITIES PRIOR TO INSTALLATION. EXACT LAYOUT CONFIGURATION WILL BE SITE SPECIFIC. ALL WORK SHALL BE CONSTRUCTED IN ACCORDANCE WITH THE LATEST EDITION OF THE RIVIERA UTILITIES' STANDARD DETAILS.

1		Driveway Construction and Notes for Electrical	07-06-23	JS		
NO.		REVISION	DATE	ENG	DATE	ISSUED FOR

RIVIERA UTILITIES

413 East Laurel Ave.  
Foley, Alabama 36535

DESIGN	JS	APPROVED	TLS
DRAWN	CM	APPROVED	TLS
ENG	JS		
PROJ MGR	JS		
CHECK	LK	DATE	01/01/2019



LIFT STATION

SCALE	NO SCALE
DWG NO.	S-10
SHEET	2 of 2