


**Riviera Utilities**  
**Underground Temporary Service Specifications**  
 Minimum 4" X 4" Treated Wood Pole


NOTE These specs are Riviera's minimum requirements  
CONTACT LOCAL CITY INSPECTION DEPTS. FOR ADDITIONAL REQUIREMENTS.

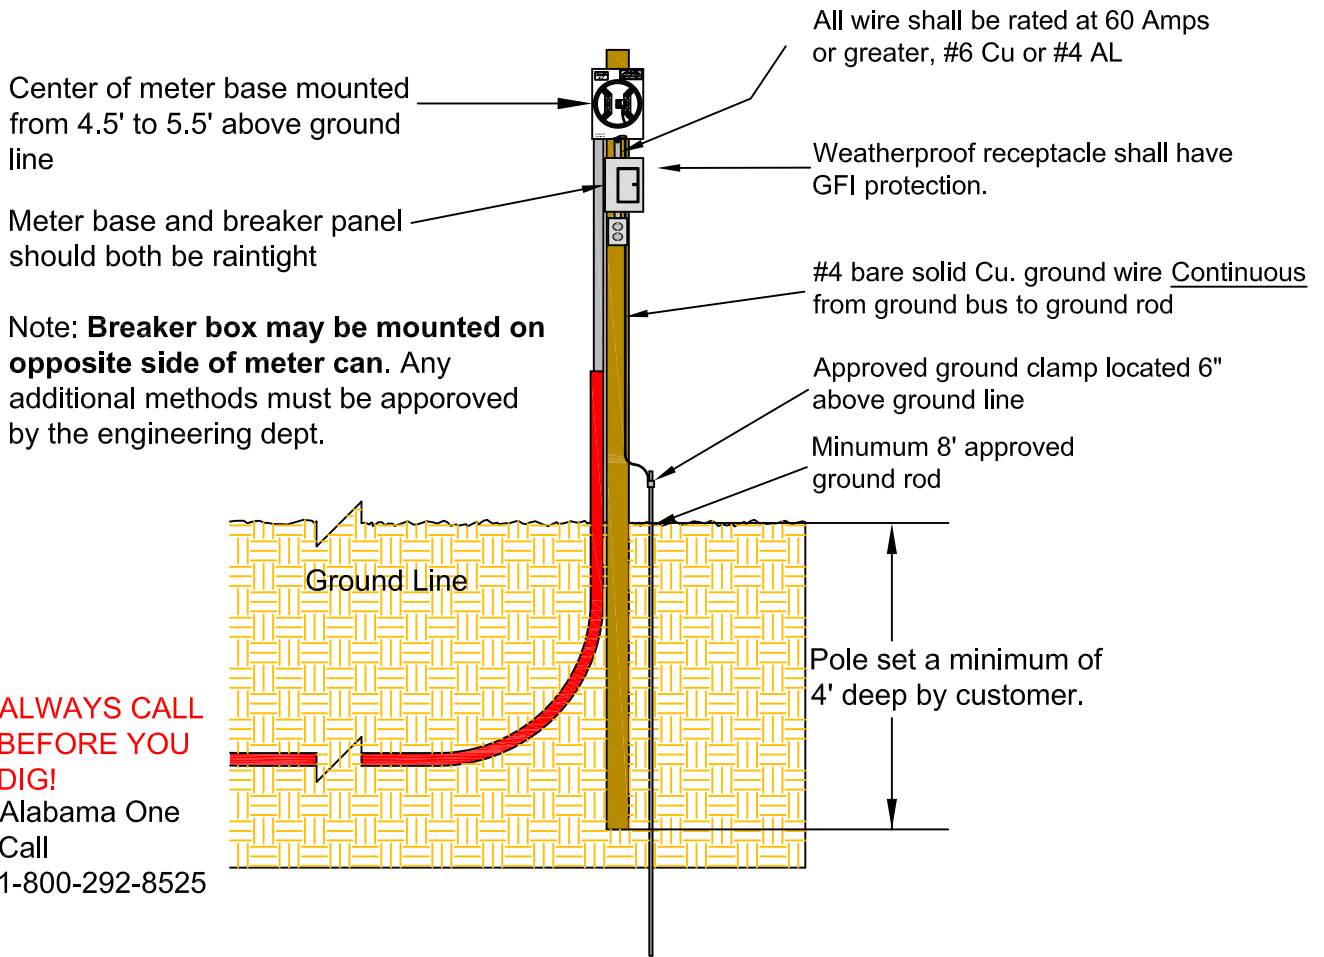

**ALWAYS CALL  
 BEFORE YOU  
 DIG!**  
 Alabama One  
 Call  
 1-800-292-8525

**NOTES:**

1. Location of temporary pole shall be determined by Riviera Utilities.

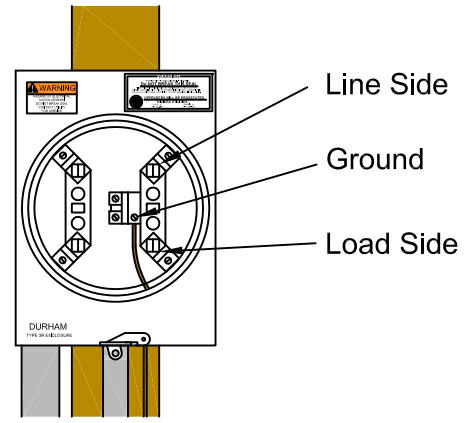

Design Parameters:	REV.	DESC.	DATE	<b>RIVIERA UTILITIES</b>		
				<b>120/240V SECONDARY, 1 PHASE, UNDERGROUND TEMPORARY SERVICE</b>		
				DRAWN BY: S. TIRADOR	CHKD BY:	
				APP'D BY:	DATE: 2/12/14	UM8.1G
				4/13		